


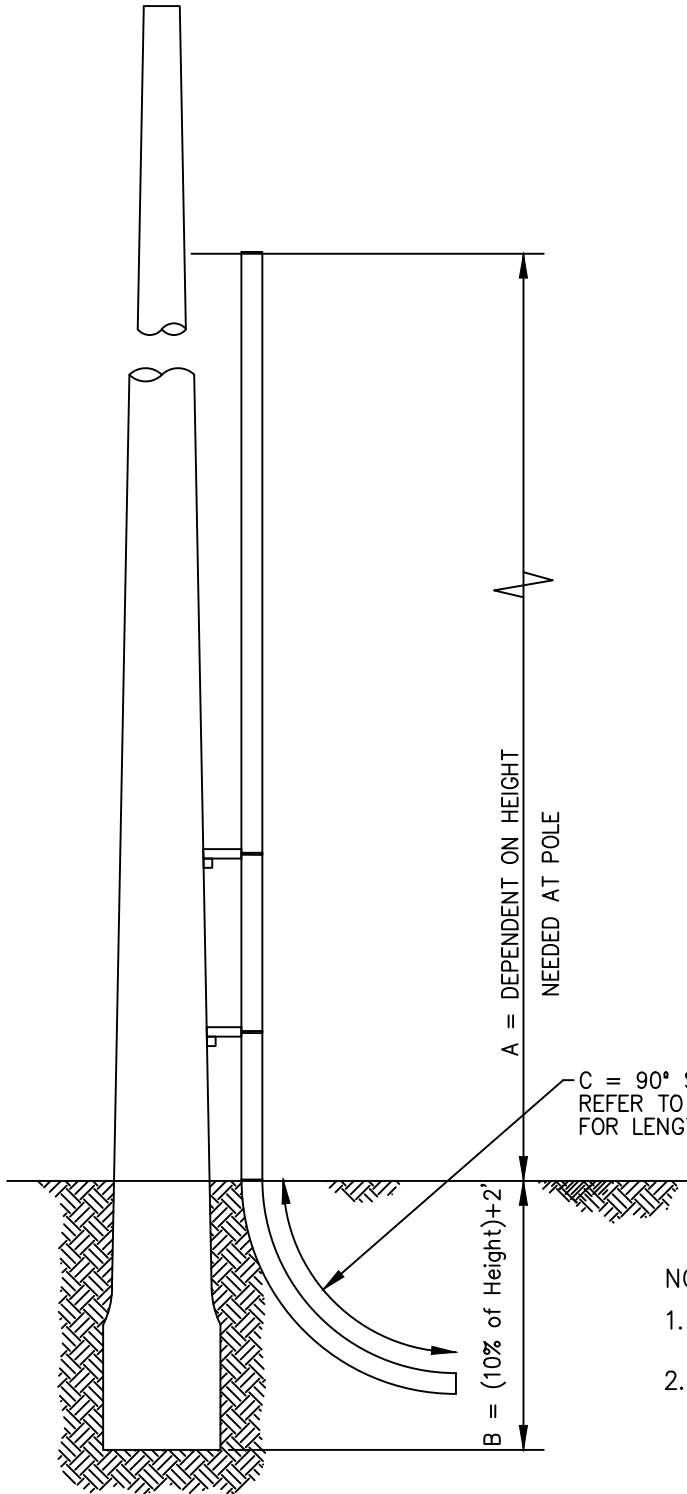

SWEEP LENGTHS

RADIUS	LENGTH
2'	3.14'
3'	4.71'
4'	6.28'
5'	7.85'

CABLE ESTIMATION

MAKE READY (AT POLE) + A + C + TRENCH LENGTH
+ MAKE READY (AT UG EQUIPMENT)

NOTES:

1. FIRST 10' CONDUIT STICK MUST BE LANDED ON STANDOFF BRACKETS ATTACHED TO POLE
2. CONDUIT DEPTH MUST BE 4'



AUBURN ELECTRIC DEPT.

UG PRIMARY ELECTRIC FOOTAGE PLANNING

NOT TO SCALE

DATE: 26-NOV-2024