




NOTE:

- 1. IF NONMETALLIC CONDUIT, SCHEDULE 80 OR BETTER IS TO BE USED, ABOVE GRADE.
- 2. MUST HAVE FOUNDATION OVERPOUR CLEARED FOR RISER PIPE
- 3. DISCONNECT BY METER BASE ON CUSTOMER SIDE IF MAIN PANEL IS MORE THAN 8' FROM METER

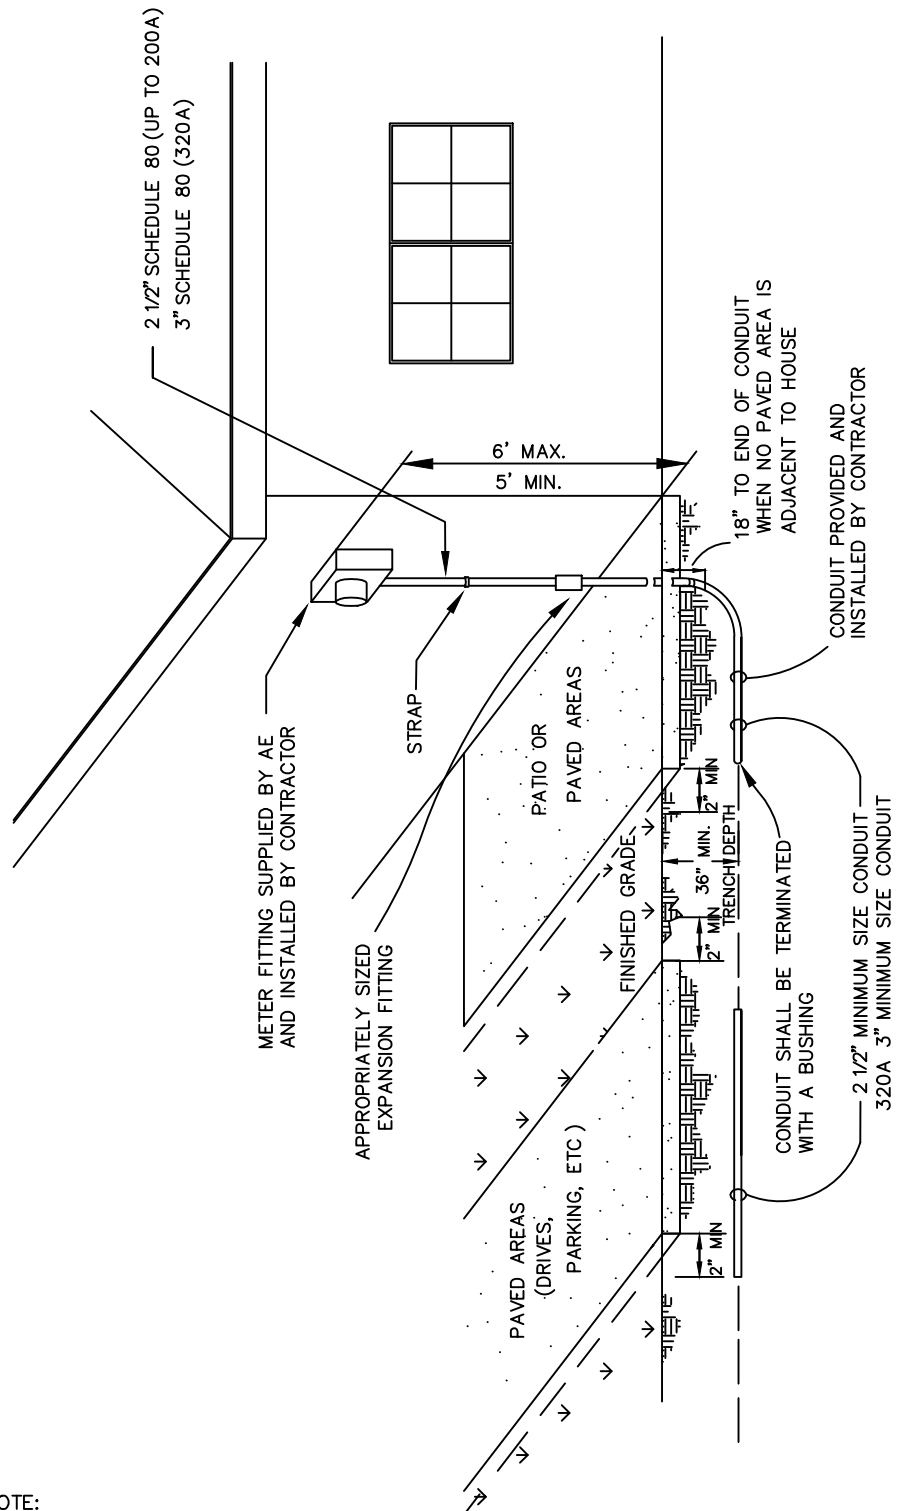

AUBURN ELECTRIC DEPT.

Underground-Residential-Service
200A/320A 3-Wire Single Phase

NOT TO SCALE
DATE: 26-NOV-2024