




1. 2-1/2" Schedule Pipe
2. Service Cable 18" Out of Weatherhead, Neutral Marked
3. Disconnect By Meter Base on Customer Side if Main Panel is More Than 8' From Meter

NOTE:

CONTRACTOR TO FURNISH AND INSTALL A MINIMUM
SIZE 3/8" GALVANIZED LAG SCREW EYE OR EYE
BOLT OR HOUSE KNOB FOR ATTACHMENT OF SERVICE DROP

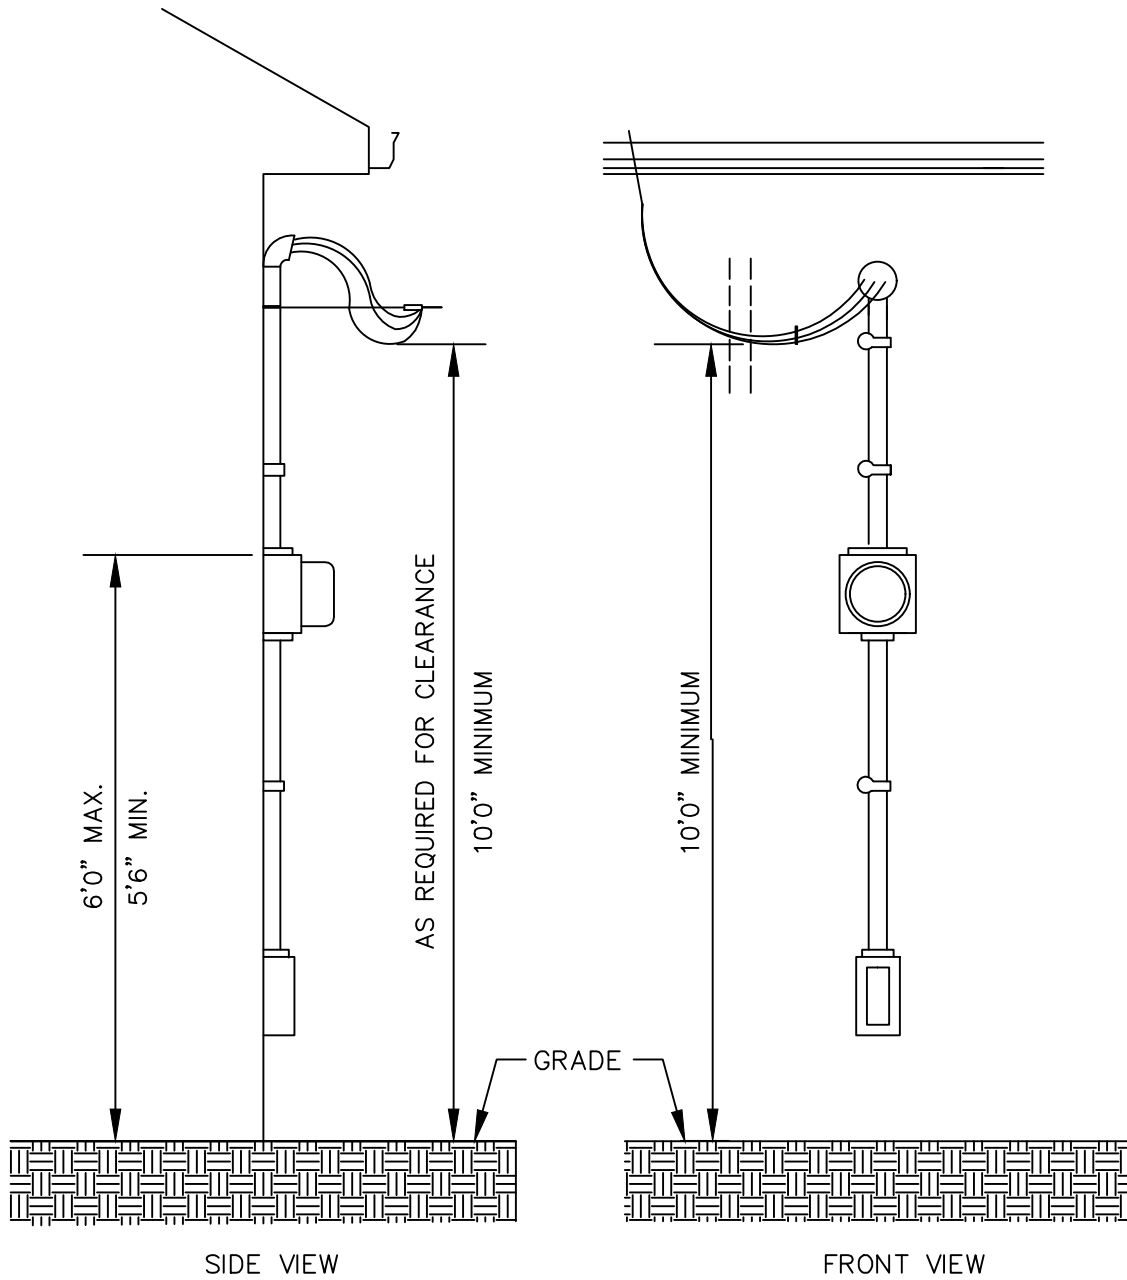

AUBURN ELECTRIC DEPT.

Triplex-Service-Connection-Below-Roof
Maximum-200A-320A

NOT TO SCALE

DATE: 26-NOV-2024